

# NOTICE OF FILING OF ADDENDUM

## By Henvey Inlet Wind LP for a Transmission Line

**Name:** Transmission Line for the Henvey Inlet Wind Energy Centre

**Location:** District of Parry Sound, Ontario

### Description:

Henvey Inlet Wind LP ("HIW"), a limited partnership between Pattern Renewable Holdings Canada ULC and Nigig Power Corporation, has completed an Environmental Review for the construction of a Transmission Line which will deliver electricity generated from the Henvey Inlet Wind Energy Centre, located on the Henvey Inlet First Nation Reserve No. 2 (HIFN I.R. #2), to the Ontario electricity grid. The HIW Transmission Line is subject to Ontario Regulation 116/01 and is subject to a "Category B" Environmental Review as described in the Ministry of the Environment and Climate Change's "Guide to Environmental Assessment Requirements for Electricity Projects" (the Guide) (January 2011).

A Final Environmental Review Report (ERR) for the HIW Transmission Line was completed in September 2015. Since then, minor changes have been made to the HIW Transmission Line alignment, requiring the preparation of an Addendum to the Final ERR. The purpose of the Addendum is to provide details regarding the changes to the alignment, why they were necessary and describe the corresponding potential environmental effects, proposed mitigation measures and monitoring practices associated with these changes.

The Addendum concludes that the changes to the Transmission Line will have no significant net environmental effects, during construction, operation or decommissioning. HIW intends to proceed with the construction of the Transmission Line, subject to the application of mitigation measures and obtaining the necessary approvals.

**The purpose of this Notice is to inform all interested parties that the Addendum (#1) to the Final ERR for the HIW Transmission Line has been completed in accordance with the Guide and is now available for review on HIW's website ([www.henveyinletwind.com](http://www.henveyinletwind.com)) for 30 calendar days from August 8 to September 8, 2016.**

### Project Contacts, Further Information and Requests:

For any questions and comments regarding this Addendum, please contact:


**Kim Sachtleben**, Project Developer *and/or*

**Ken Noble**, Project Developer

*Email:* [info@henveyinletwind.com](mailto:info@henveyinletwind.com)

*Phone:* (705) 857-5265

*Mail:* Henvey Inlet Wind Office  
295 Pickering River Road  
Pickering, ON P0G 1J0

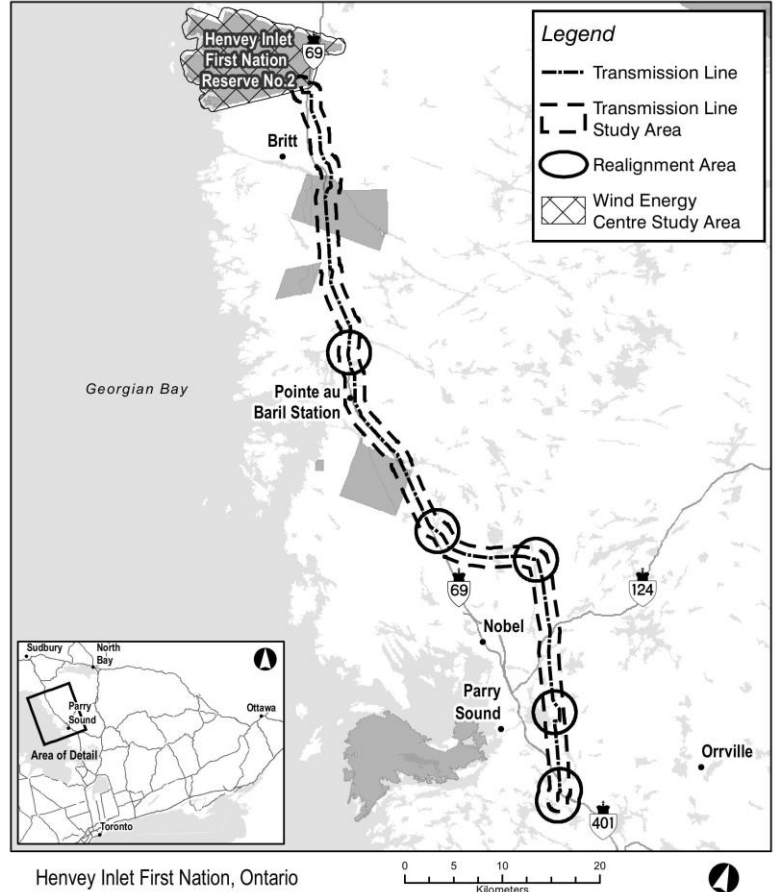

If upon review of the Addendum to the ERR, an interested party has outstanding concerns about the changes to the Transmission Line, they should be raised with HIW as soon as possible. In the event that issues cannot be resolved, the concerned party may make a written request during the 30-day review period to the Director of the Ministry of the Environment and Climate Change, Environmental Approvals Branch, at the address noted below, to elevate the changes to the HIW Transmission Line to an Individual Environmental Assessment under the Ontario *Environmental Assessment Act (1990)*. A copy of the elevation request must also be sent to HIW at the above-noted address.

**Sarah Paul and Katherine Hedley**, Directors  
Environmental Approvals Branch  
Ministry of the Environment and Climate Change  
135 St. Clair Avenue West, 1st Floor  
Toronto, Ontario M4V 1P5

**Elevation requests must be made in accordance with the provisions set out in the Guide and must be received by the Director of the Environmental Approvals Branch. The last date for requests for elevation is September 8, 2016.** A copy of the Guide is available on the Government of Ontario website at: [www.ontario.ca/document/guide-environmental-assessment-requirements-electricity-projects](http://www.ontario.ca/document/guide-environmental-assessment-requirements-electricity-projects).