

NOTICE OF FILING OF ADDENDUM #2

By Henvey Inlet Wind LP for a Transmission Line

Name: Transmission Line for the Henvey Inlet Wind Energy Centre

Location: District of Parry Sound, Ontario

Description:

Henvey Inlet Wind LP ("HIW"), a limited partnership between Pattern Renewable Holdings Canada ULC and Nigig Power Corporation, has completed an Environmental Review for the construction of a Transmission Line which will deliver electricity generated from the Henvey Inlet Wind Energy Centre, located on the Henvey Inlet First Nation Reserve No. 2 (HIFN I.R. #2), to the Ontario electricity grid. The HIW Transmission Line is subject to Ontario Regulation 116/01 and is subject to a "Category B" Environmental Review as described in the Ministry of the Environment and Climate Change's "Guide to Environmental Assessment Requirements for Electricity Projects" (the Guide) (January 2011).

A Final Environmental Review Report (ERR) for the HIW Transmission Line was completed in September 2015. Since then, minor changes have been made to the HIW Transmission Line alignment, requiring the preparation of an Addendum to the Final ERR. Addendum #1 was issued in August 2016 to address changes where the Transmission Line alignment moved outside of the original 50m easement but remained within the Transmission Line study area documented in the Final ERR. The purpose of this Addendum #2 is to address changes to the Transmission Line alignment and interconnect siting introduced after the publication of Addendum #1.

The Addendum concludes that the changes to the Transmission Line will have no significant net environmental effects, during construction, operation or decommissioning. HIW intends to proceed with the construction of the Transmission Line, subject to the application of mitigation measures and obtaining the necessary approvals.

The purpose of this Notice is to inform all interested parties that the Addendum (#2) to the Final ERR for the HIW Transmission Line has been completed in accordance with the Guide and is now available for review on HIW's website (www.henveyinletwind.com) for 30 calendar days from September 20 to October 20, 2017.

Project Contacts, Further Information and Requests:

For any questions and comments regarding this Addendum, please contact:

Kim Sachtleben, Project Developer *and/or*

Ken Noble, Project Developer


Email: info@henveyinletwind.com

Phone: (705) 857-5265

Mail: Henvey Inlet Wind Office

295 Pickerel River Road

Pickerel, ON P0G 1J0

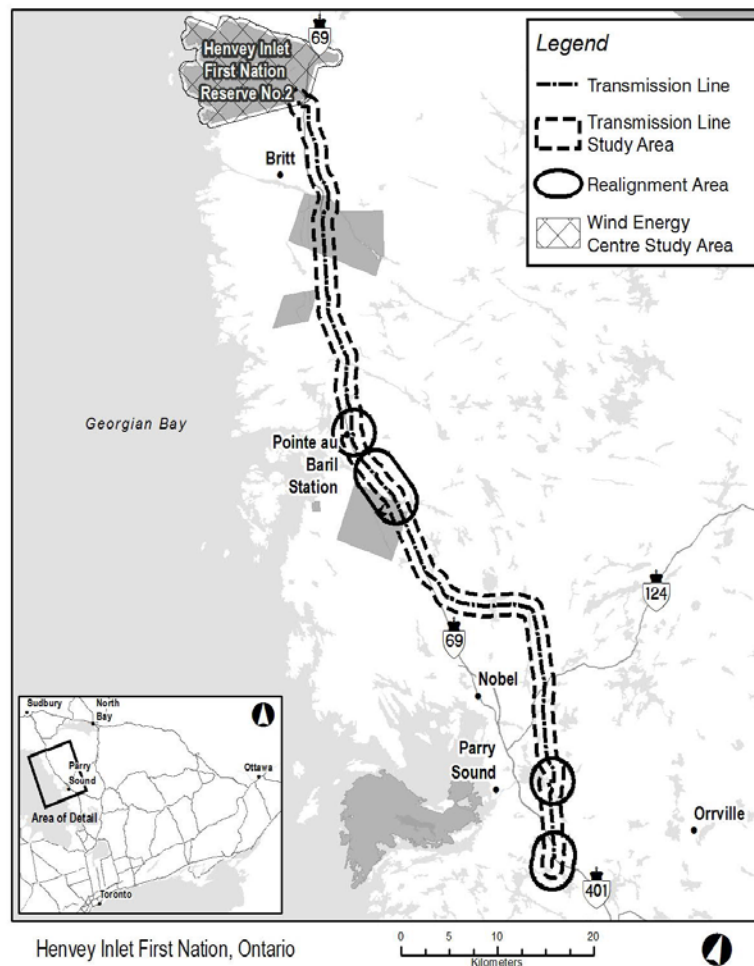

If upon review of the Addendum to the ERR, an interested party has outstanding concerns about the changes to the Transmission Line, they should be raised with HIW as soon as possible. In the event that issues cannot be resolved, the concerned party may make a written request during the 30-day review period to the Director of the Ministry of the Environment and Climate Change, Environmental Approvals Branch, at the address noted below, to elevate the changes to the HIW Transmission Line to an Individual Environmental Assessment under the Ontario *Environmental Assessment Act (1990)*. A copy of the elevation request must also be sent to HIW at the above-noted address.

Kathleen O'Neill, Director
Environmental Approvals Branch
Ministry of the Environment and Climate Change
135 St. Clair Avenue West, 1st Floor
Toronto, Ontario M4V 1P5

Elevation requests must be made in accordance with the provisions set out in the Guide and must be received by the Director of the Environmental Approvals Branch. The last date for requests for elevation is October 20, 2017. A copy of the Guide is available on the Government of Ontario website at: www.ontario.ca/document/guide-environmental-assessment-requirements-electricity-projects.